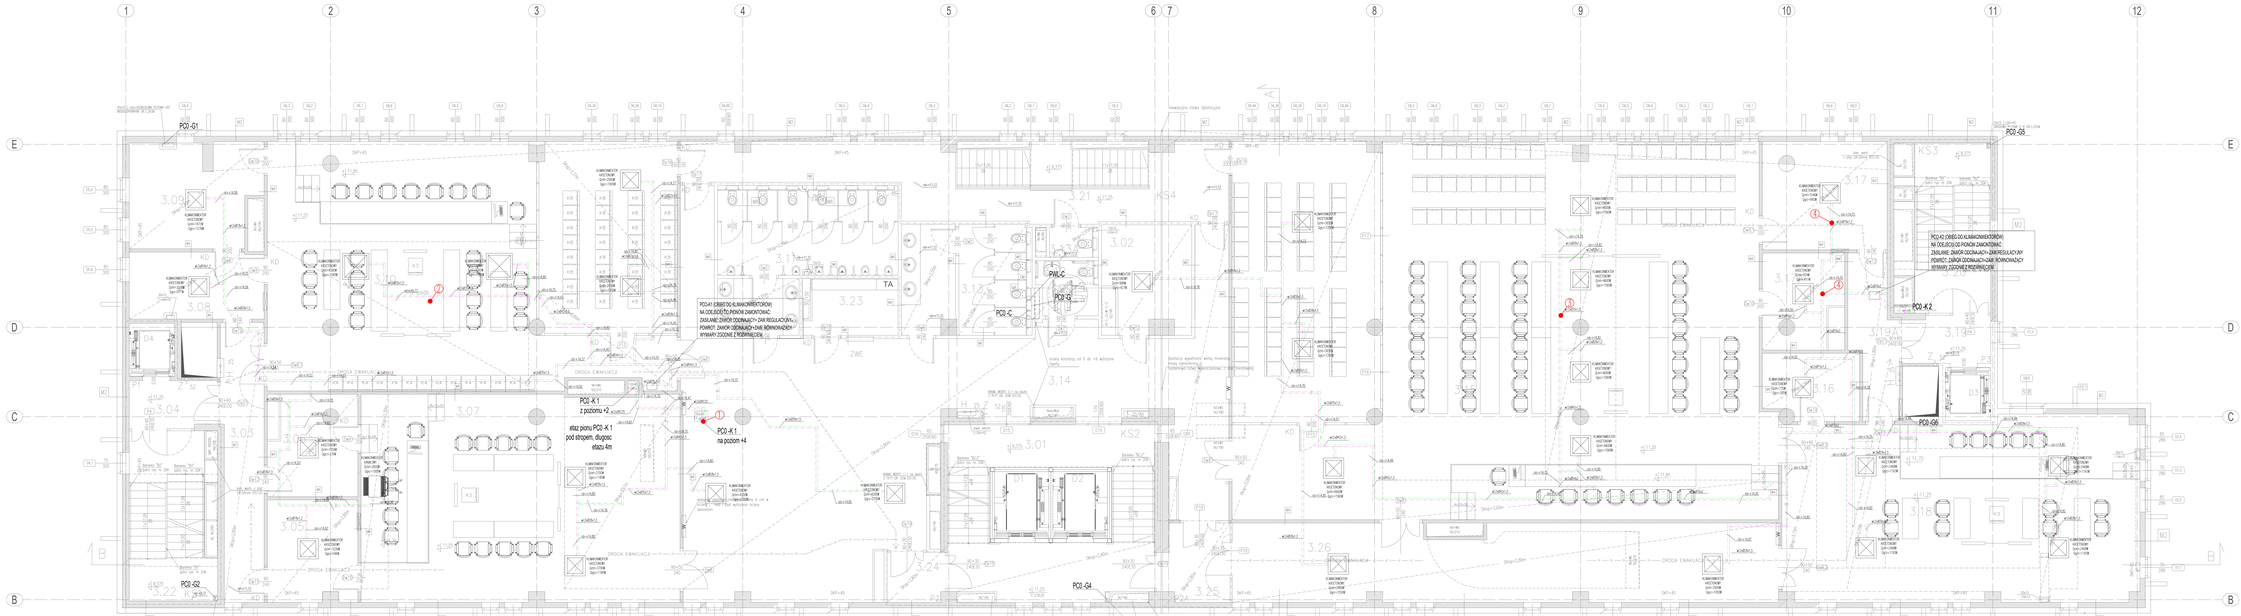
PCI2-G1
PCI2-G2
PCI2-G3
PCI2-G4
PCI2-G5
PCI2-G6
PCI2-K.1
z pozomu +2
etaz pionu PCI2-K.1
pod stropem, długosc
etazu 4m
PCI2-K.1
na poziom +4
PCI2-K.2
PCI2-C
PWLC
PCI2-IG
PCI2-IG DEDICATED TO AIR CONDITIONING
IN CASE OF OUTDOOR TEMPERATURE:
- COOLING ABOVE + 24 ° C
- HEATING BELOW + 20 ° C
POWER SUPPLY FOR AIR CONDITIONERS
IN THE ZONE
PCI2-IG DEDICATED TO AIR CONDITIONING
IN CASE OF OUTDOOR TEMPERATURE:
- COOLING ABOVE + 24 ° C
- HEATING BELOW + 20 ° C
POWER SUPPLY FOR AIR CONDITIONERS
IN THE ZONE
DROGA EWAKUACJI
TA
ZRE
KS1
KS2
KS3
KS4
KD
K1
K2
K3
K4
K5
K6
K7
K8
K9
K10
K11
K12
K13
K14
K15
K16
K17
K18
K19
K20
K21
K22
K23
K24
K25
K26
K27
K28
K29
K30
K31
K32
K33
K34
K35
K36
K37
K38
K39
K40