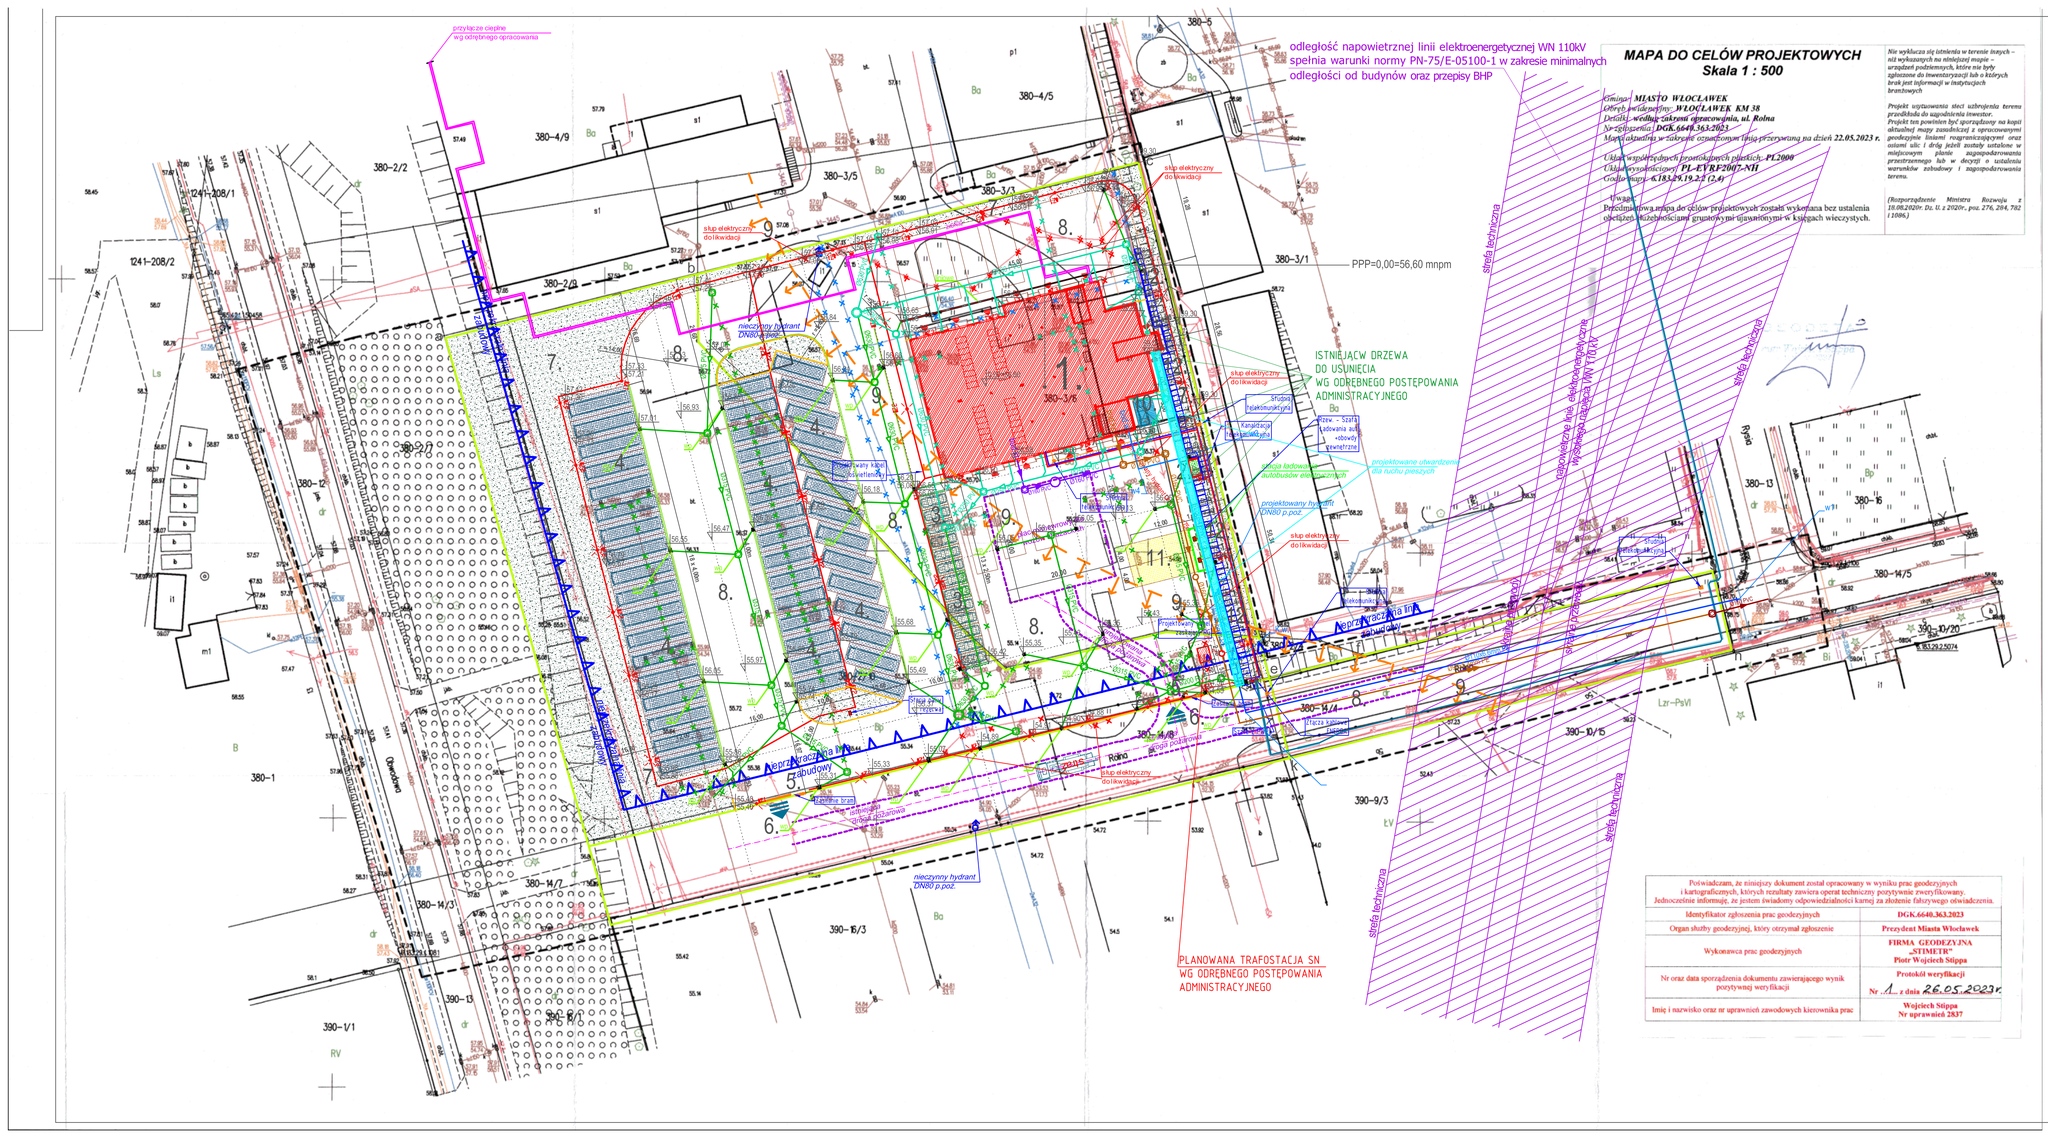
przyłącze cieplne wg odrębnego opracowania
odległość napowietrznej linii elektroenergetycznej WN 110kV spełnia warunki normy PN-75/E-05100-1 w zakresie minimalnych odległości od budynów oraz przepisy BHP
PPP=0,00=56,60 mnpm
ISTNIEJĄCE DRZEWA DO USUNIĘCIA WG ODRĘBNEGO POSTĘPOWANIA ADMINISTRACYJNEGO
PLANOWANA TRAFOSTACJA SN WG ODRĘBNEGO POSTĘPOWANIA ADMINISTRACYJNEGO
strefa techniczna
napowietrzna linia elektroenergetyczna WN 110kV
projektowane utwardzenie dla ruchu pieszych
projektowany hydrant DN80 p.poż.
nieczynny hydrant DN80 p.poż.
słup elektryczny dolikwidacji
Rzeka Bystrzyca
Lzr-PsVI
Lzr-Sz/Pl
Lzr-Sz/Ps
Lzr-Sz/Ps/Pl
Lzr-Sz/Ps/Pl/Ps
Lzr-Sz/Ps/Pl/Ps/Pl
Lzr-Sz/Ps/Pl/Ps/Pl/Ps
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl
Lzr-Sz/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps/Pl/Ps